




# Valparaiso City Utilities

205 Billings Street  
Valparaiso, Indiana 46383-3699

*"Water is our Most Valuable Natural Resource"*

## METER DIAGRAM – ¾" AND 1" FOR HIGH PRESSURE ZONES – 70# & HIGHER

- ALL BACKFLOW PREVENTION DEVICES and ALL PRESSURE REDUCING VALVES must be connected AFTER the meter assembly.
- Minimum floor clearance: 2'-4" / Minimum wall distance: 6"
- 1" K Copper from curb box through wall to meter yoke.
- AFTER METER YOKE, customer can use any material (including plastic).
- Thermal Expansion Tank near hot water heater on cold water side (recommended but not required).
- **NO VALVES BEFORE METER YOKE**
- Meter's normal flow (GPM):
  - ¾" Meter – 2 – 30
  - 1" Meter – 3 – 50

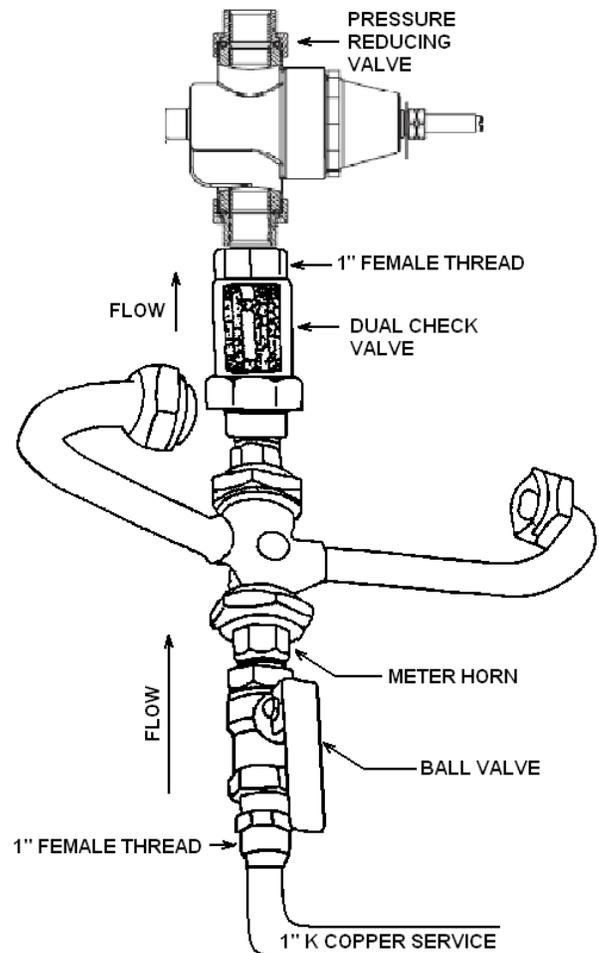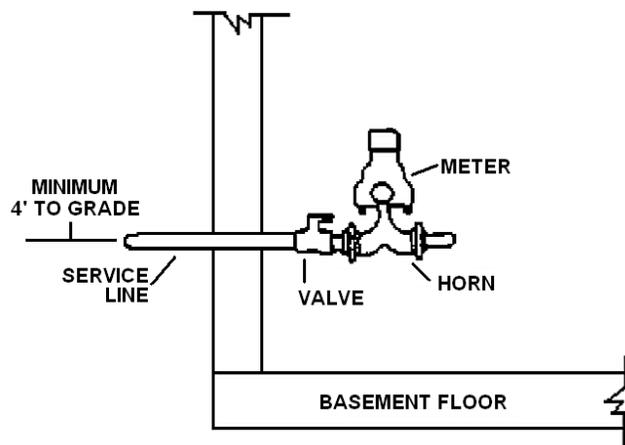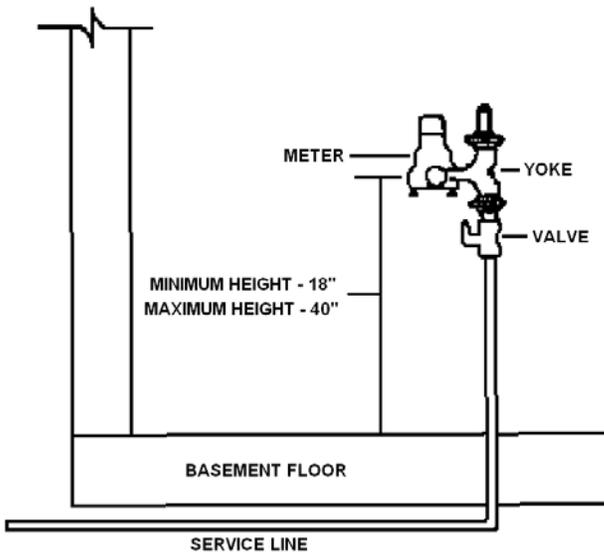

METER INSTALLATION EQUIPMENT

For additional information, visit our website at [www.valparaisoutilities.org](http://www.valparaisoutilities.org) and click on Builder Assistance under Quick Access.