


NOTES: 1) IF USING PRESSURE VACCUUM BREAKER (PVB),
THE PVB MUST BE A MINIMUM OF 12-INCHES
HIGHER THAN ANY WATER SOURCE.

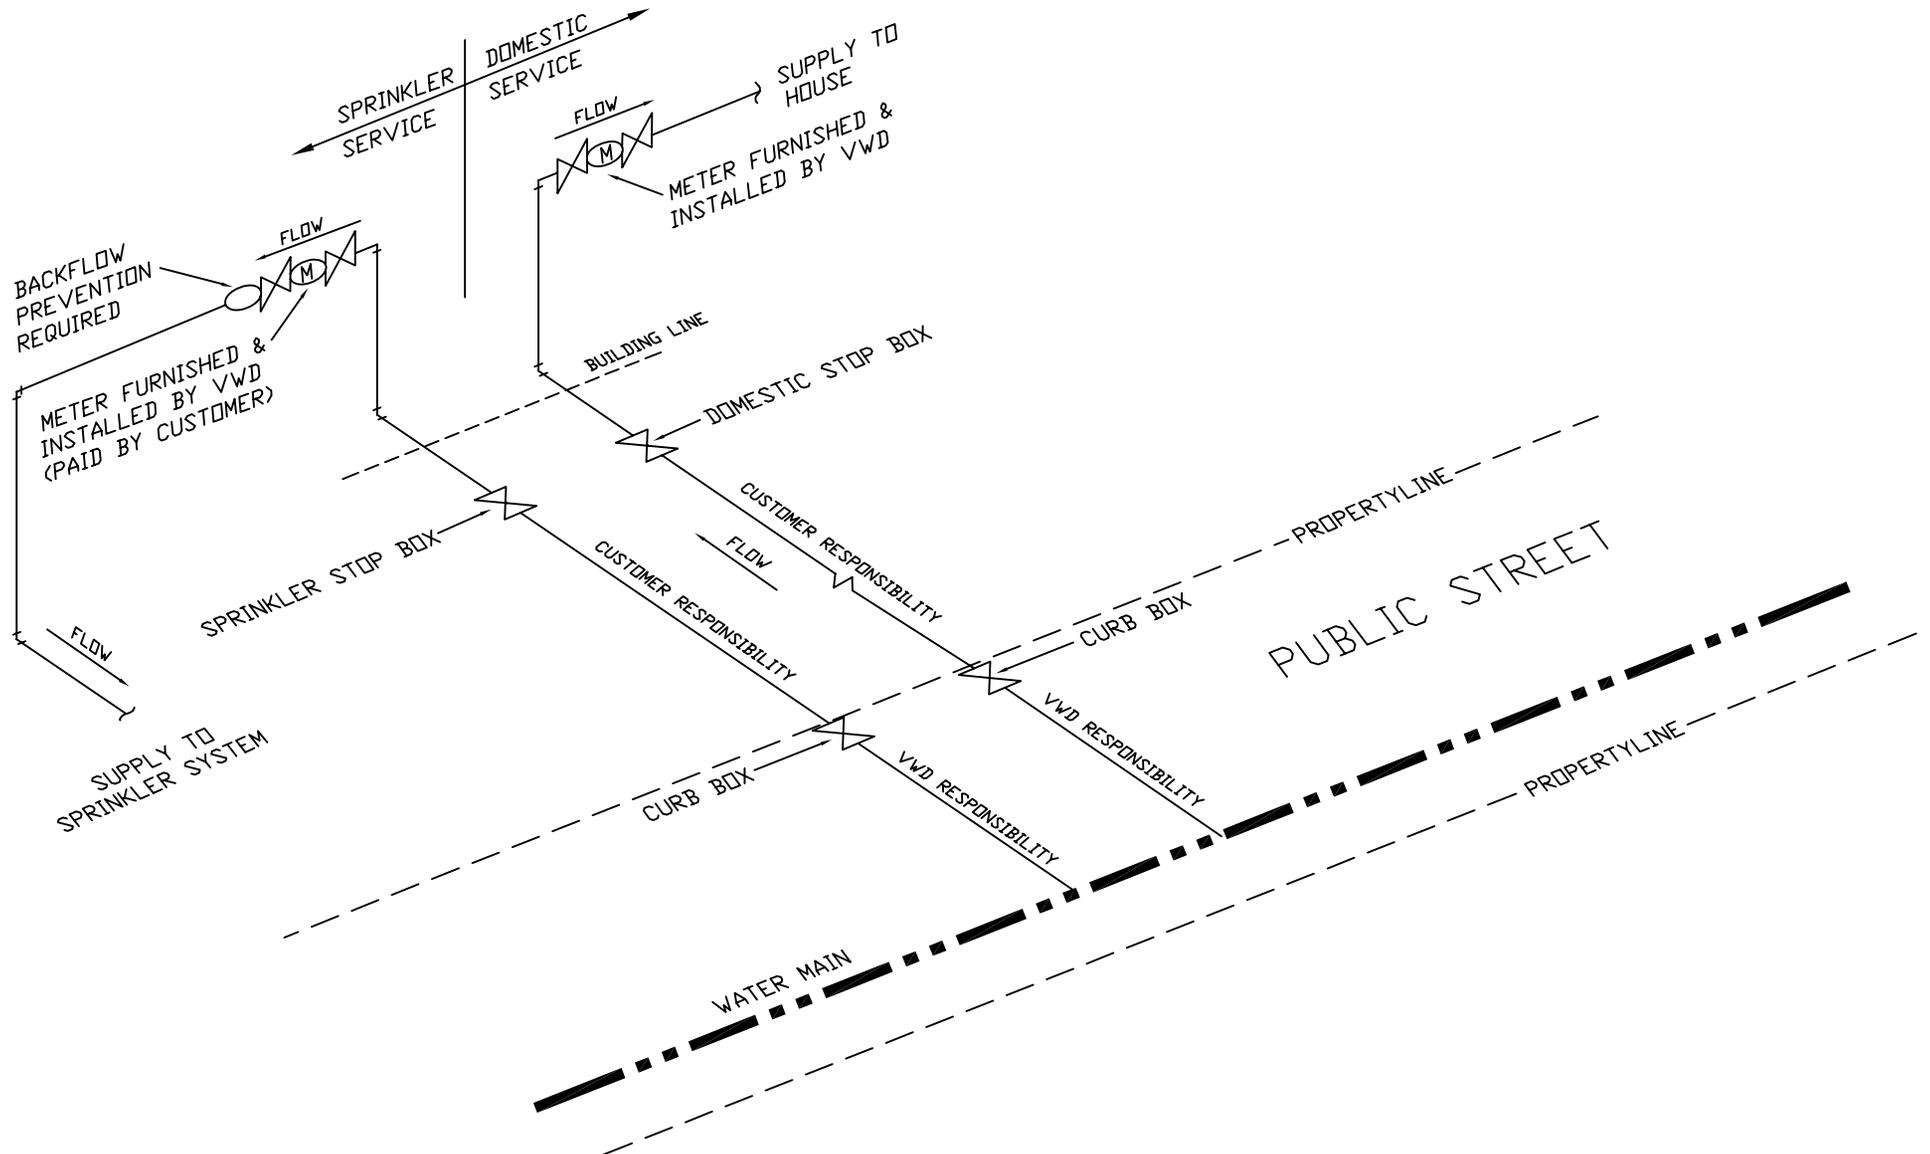

SEPARATE DOMESTIC & SPRINKLER METERS (IN PARALLEL)
VALPARAISO CITY UTILITIES - WATER DEPARTMENT
SCALE: N.T.S.
LAST UPDATE: 05/17/06