


**SECTION 02290
CONSTRUCTION DETAILS**

Detail A: Hydrant Detail

Detail B: Valve/Curb Box Detail

Detail C: Trench Detail

END OF SECTION

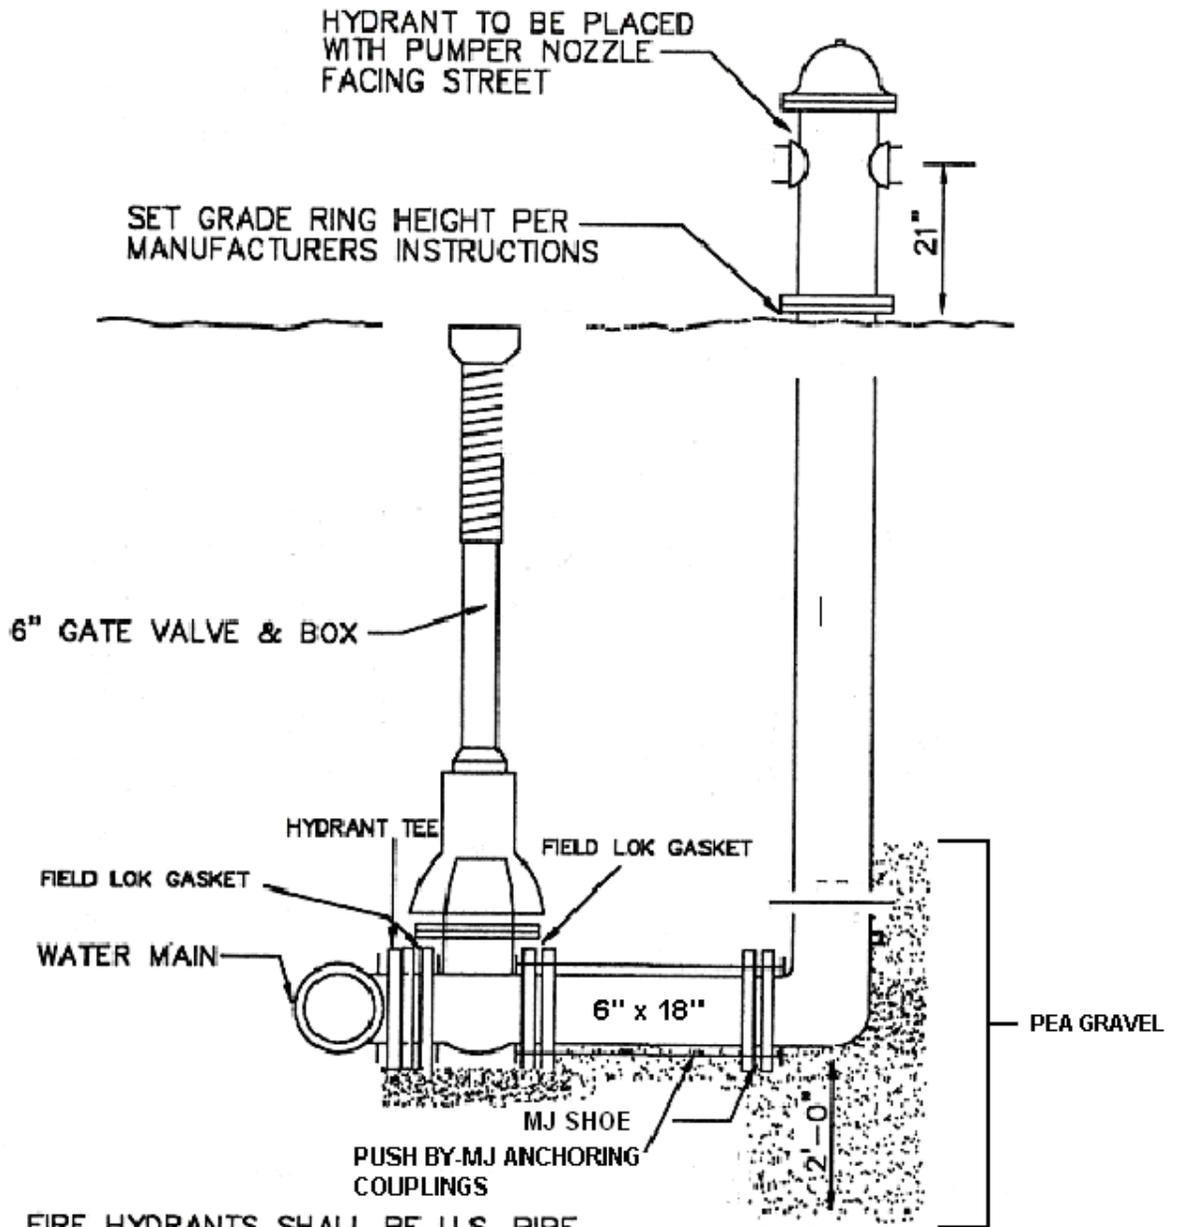


NOTE: FIRE HYDRANTS SHALL BE U.S. PIPE METROPOLITAN M-94 WITH AN MJ SHOE.

DETAIL A - HYDRANT DETAIL

(NOT TO SCALE)


SET VALVE COVER FLUSH
WITH SURFACE - COVER
SHALL BE STAMPED WITH
THE WORD WATER

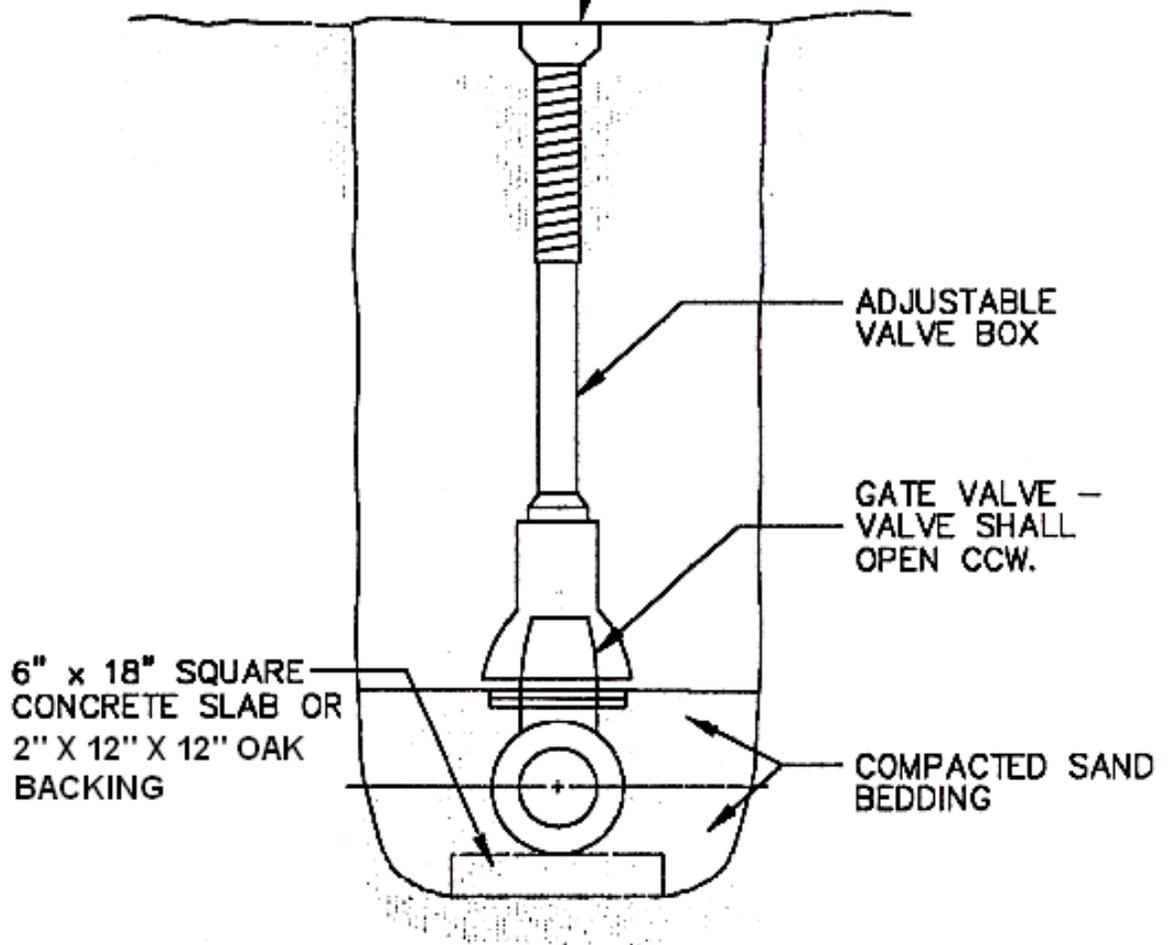

NOTE: FOR 1.5 AND 2-INCH SERVICES, AN FIP X FIP CURB STOP SHALL BE USED AND IT SHALL BE CONNECTED TO AN ENLARGED CURB BOX BASE AND THEN THE ENLARGED CURB BOX BASE SHALL BE CONNECTED TO THE CURB BOX.

DETAIL B - VALVE / CURB BOX DETAIL
(NOT TO SCALE)

SEE PAVEMENT DETAILS

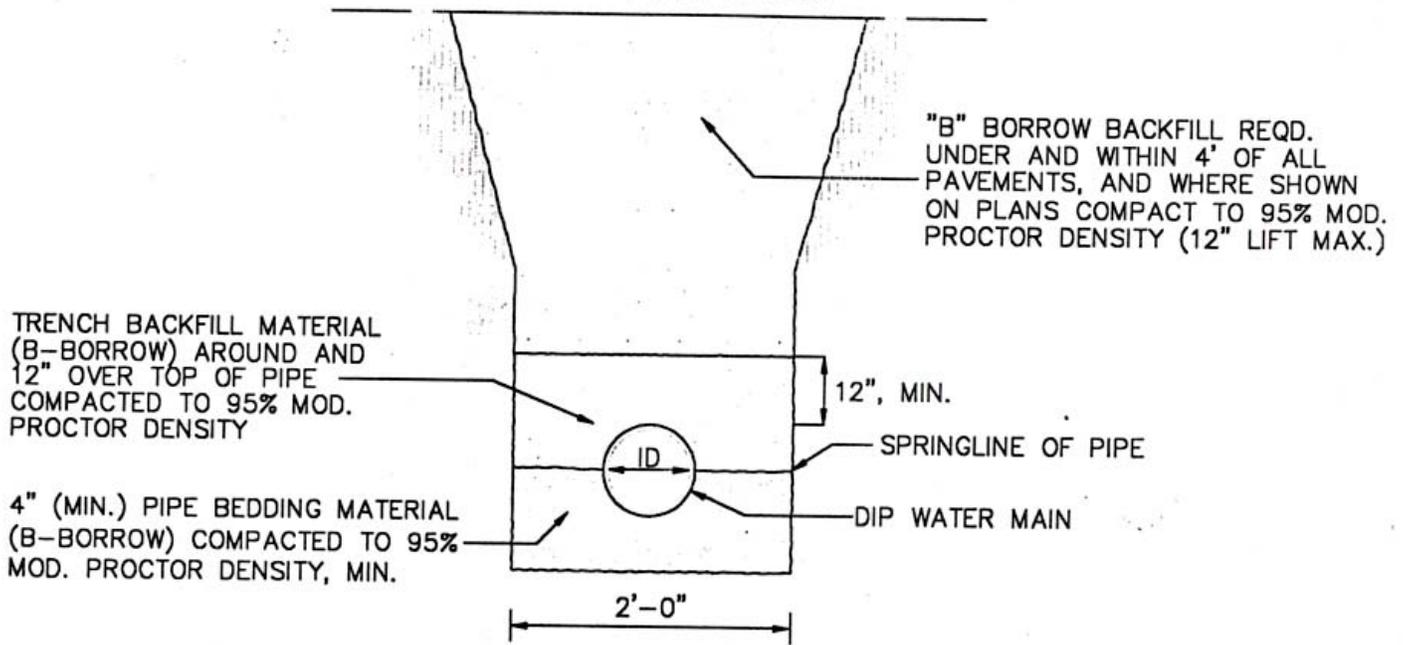

DETAIL C – SERVICE CONNECTION DETAIL
(NOT TO SCALE)